

Exergetic comparison of different oxyfuel technologies

Isabel Guedea¹, Carlos Lupiañez², Luis M. Romeo^{*3}

^{1,2,3} CIRCE (Research Centre for Energy Resources and Consumption),
Universidad de Zaragoza, Mariano Esquillor, 15, 50018 Zaragoza, Spain.

Received Date: 26 Apr.; 2011

Accepted: 24 May.; 2011

ABSTRACT

Carbon Capture and Storage (CCS) systems have relevant energy consumption associated with the CO₂ capture process. It causes an energy efficiency reduction that diminishes the economic interests and increases the technical uncertainty of these systems. With the objective of improving the system performance and reducing thermodynamic inefficiencies, the exergy analysis has been traditionally applied as a guide for design process. This work presents and compares energy and exergy analysis of two CCS systems based on pressurized oxyfuel combustion, a pressurized fluidized bed combustion working under oxyfiring conditions and a chemical looping combustion using coal as fuel. The aim is to calculate CCS energy and exergy penalties, detecting irreversibilities and proposing items for optimization. It is demonstrated that opposed to energy penalty, the exergy losses do extend neither in the same quantity nor in the same equipment, leading to outstanding conclusions for system improvements. As it will be demonstrated, the exergy penalty of additional equipment for CO₂ capture does not cause relevant losses and these irreversibilities are concentrated in several systems that should be redesigned or analysed in detail to reduce the losses.

Keywords

CO₂ capture, exergy analysis, pressurized combustion, fluidized bed, chemical looping combustion

1. Introduction

One of the main obstacles for the deployment of Carbon Capture and Storage (CCS) systems is the important energy consumption associated with the CO₂ capture process. This causes an increment of the operational cost that, joined to the capital cost uncertainties, reduces the attractiveness to step forward the commercial stage. In spite of these transient drawbacks, Intergovernmental Panel on Climate Change (IPCC) and European Technology Platform for Zero Emission Fossil Fuel Power Plants (ZEP) consider CCS one of the options to reduce greenhouse gases emissions in medium-long term [1-2].

To increase the system performance and reduce the inefficiencies the exergy analysis has

been traditionally used as a guide. It has demonstrated good results in the synthesis of complex systems and efficiency improvements in energy applications. This work presents an exergy analysis of two CCS systems based on pressurized oxyfuel combustion. The aim is to reduce CCS energy penalties, detecting irreversibilities and proposing items for optimization.

Due to the novelty of CCS, there is a lack of literature related to the exergy analysis of different capture systems. A pioneering application of this kind of analysis applied to CO₂ capture systems is the use of the exergy of liquid natural gas to reduce the energy consumption of oxygen production in an oxyfuel combined cycle [3]. Also,

* Corresponding author: Luis M. Romeo (e-mail: luismi@unizar.es)
Tel.+34-976-761863; Fax: +34-976-732078.)

exergy analysis has been used in amine scrubbing applications to conclude that the exergy losses in stripper and reboiler were smaller than losses in the flasher and that the pressure drop over the absorber had a strong influence on exergy destruction, and finally, based on the results, they proposed items for optimization [4-5]. Oxyfuel and chemical looping power cycles have also deserved attention on the literature [6-19]. The exergy regeneration performances were investigated for the chemical recuperation with CO₂-NG reforming [6-8] in oxyfuel power cycles. Chemical looping combustion with gas turbine cycles [9], comparing different oxygen carriers [10], H₂ production [11-12], and power cycles based on oxyfuel+GT [13-18] and Ca-looping [19] have also been studied.

Aiming the efficiency maximization, precombustion, gasification and high pressure combustion systems have an undoubtedly interest and represent an interesting option. Looking for reducing energetic requirements, high pressure combustion could decrease CO₂ conditioning and compression demands, having an important effect on net efficiency and cost reductions of CCS power plants. The possibility to incorporate a gas turbine or even to take advantage of the water-condensing flue gases energy recovery are other possible advantages of these options. In the literature it can be found two main possibilities to include a pressurized coal combustor [20-22]. Research carried out by MIT and ENEL [20] is focused in oxyfuel combustion using pressurized coal technology. No details are described about the combustor design, but they show an intensive work with steam cycle integration and flue gas pre-treatment. The conclusions were interesting values of net power plant efficiency with carbon capture of 34.8% based on Low Heating Value (LHV) and a gross efficiency of 47.6%. The work of KTH [21-22] proposes a hybrid combined cycle with pressurized fluidized bed combustion (PFBC) and CO₂ capture. They join a gas turbine as a topping cycle with a PFBC as a bottoming cycle plus the CO₂ capture system with a hot potassium carbonate process with a regeneration heat of 1.85 MJ/kg CO₂. Results are excellent and encouraging with power plant efficiencies of 43.9% with CO₂ capture. However, the complexity of the process increases sharply and cost fig-

ures, not included in the study conducted, should increase in parallel.

Recently, the pressurized chemical looping combustion with combined cycle has been proposed as a possible solution to increase thermal efficiency when coal is used as fuel in chemical looping combustion [23-25]. The use of solid fuels in chemical looping combustion has deserved attention by outstanding researchers in the field [26-30], although nowadays, the main interest is focused in the use of gaseous fuels [31-33]. For some coals, operating temperature should be limited to avoid ash melting in the reactor; the use of pressurized reactor should increase system efficiency and would enable higher fuel conversion efficiency [34]. Evidently, there is a lack of literature on pressurized chemical looping combustion of solid fuels [35], but the effect of pressure on several variables of CLC has been presented elsewhere [35-36].

The aim of this work is to simulate and propose system improvements of pressurized fluidized bed oxyfuel combustion (PFBC) through an exergy analysis, comparing energy and exergy efficiencies of different equipment. Firstly, an oxyfuel pressurized fluidized bed is described and simulated, and later a pressurized chemical looping combustion (CLC) for coal is proposed and modelled.

2. PFBC cycle

2.1. Description

The first option uses a pressurized fluidized bed working under oxyfiring conditions to produce a concentrated CO₂ stream. This option has the advantage of the reduction of system size that could reduce the capital investment. For analysing and comparing this technology with pressurized CLC in literature, a 550 MW_{th} pressurized fluidized bed under oxy-firing conditions has been simulated. The software used for simulation is EES [37] that allows the solution of a set of algebraic equations, providing many built-in mathematical and thermophysical property functions useful for engineering calculations. The layout of this O₂/CO₂ PFBC system is schematically illustrated in Fig.1. Oxy-PFBC cycle is roughly divided into five main sections: the air separation unit (ASU), the pressurized fluidized

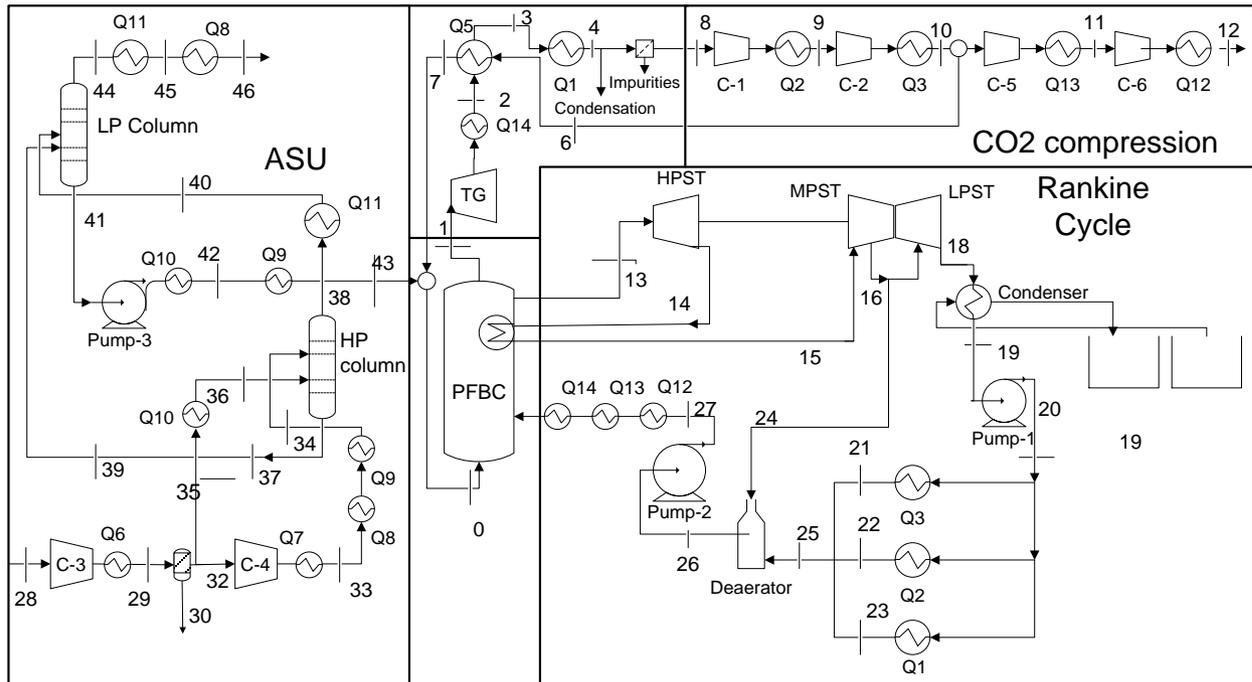


Fig. 1: PFBC cycle scheme.

bed combustor (PFBC), the CO₂ turbine, the Rankine cycle and the CO₂ compression system.

PFBC operates at 12 bar and between 800 and 850°C. Modelling is based on a previous work [38] using data of a semi-commercial power plant for validation at air conditions. For this case, the main objective is the evaluation of maximum boiler capacity (live steam production), maintaining a suitable bed temperature profile. The model inputs presented are the fed fuel (550 MW_{th}), a reasonable fluidization velocity (1.1 m/s), the Ca/S ratio (1.8) and the particle size distribution inside the bed (mean diameter 700 μm). The simulation calculates the boiler heat transfer coefficients and, with several energy balances along the bed height, the steam production and bed temperature are obtained. In PFBC the largest influence on heat transfer is the contribution of particle convection. Literature shows that similar values for this variable are obtained when fluidization changes from air to O₂/CO₂ mixtures [39]. Owing to the facts that the fluidized bed temperature has been considered the same for both cases, air and oxy-firing conditions, and the signifier contribution of the particles in the heat transfer in fluidized bed boilers, it

is reasonable to assume that literature correlations for heat transfer could be used for first estimations under oxy-firing conditions at PFBC. The bed-to-tube heat transfer coefficient results to be around 380 W/m²K, with slight variations depending on the bed height, which operates at an average temperature of 820°C.

Coal composition is shown in table 1. Due to the fact that the combustion time is much larger than the mixing time of particles, char combustion is modelled as being uniform along the bed height. Its contribution is evaluated as the oxidation of carbon, whereas the combustion of volatiles is calculated by subtracting the char energy content from the coal heating value. Volatile matter combustion is also considered to be uniform along the bed height.

For oxyfiring conditions, it is supposed a 35% oxygen concentration at PFBC inlet (0). This stream is mixed with a fraction of the exhaust gases that are recycled (57 %). The required oxygen is provided by an air separation unit (ASU) consisting on a double distillation column. The air flow entering the ASU (28) is calculated to obtain 10% of oxygen excess above stoichiometric. In order to obtain a high purity CO₂ stream

Table 1. Coal composition.

<i>Fuel Composition</i>	
C	64.46 (% d.b.)
H	2.32 (% d.b.)
N	1.20 (% d.b.)
O	6.20 (% d.b.)
S	1.04 (% d.b.)
Moisture	2.05 (% d.b.)
Ashes	26.00 (% d.b.)
<i>LHV</i>	
24009 (kJ/kg)	

the pressure level at ASU has been selected as usual, 11 bar, to obtain an oxygen purity of 95%. The ASU layout reference [40] is modified to adequate the heat transfer to the stream temperatures of the plant and to optimize the inter-cooling compression system. Distillation columns operate at low temperature, between -167°C and -180°C in the high pressure column (11 bar) and from -182°C to -202°C in the low pressure column (5.1 bar). Pure and pressurized oxygen (43) is diluted with recirculated CO₂ (7) to increase the fluidization velocity and it is injected in the Oxy-PFBC.

After the PFBC, flue gases (1) at 820°C mainly composed by CO₂ are expanded in a gas turbine and then cooled down in three heat exchangers for steam reheating, increasing the temperature of flue gas recirculation and low-pressure water preheating. After these heat exchangers, impurities as excess of oxygen or nitrogen from the ASU are eliminated. Minimum temperature difference in Q14 and Q5 is around 40 °C and flue gases intermediate temperatures result in 390°C and 235°C. After the water condensation in Q1 (4), part of the flue gases at 60°C are conducted to a 2-stage intercooled compression (8). When the fluidized bed pressure is achieved in the compression system, a fraction of the CO₂-stream (6) is recirculated as explained above and then preheated (7) until 354°C. Inter-cooling compression reduces the CO₂ temperature at compressor inlet to 60°C, leading a decrease of the power necessities. Waste energy from Q2 and Q3 is integrated as low pressure heaters in the steam cycle [41]. The two-stage compression produces a stream (12) with 92.2 % CO₂ concentration at 120 bar and 60°C.

Table 2. Simulation Assumptions.

Air properties	<i>1 bar, 15°C</i>
CO ₂ compressor pressure ratio (CLC)	3.30
CO ₂ compressor pressure ratio (PFBC)	3
Compressors isentropic efficiency	0.91
Air turbine isentropic efficiency	0.91
HP Turbine isentropic efficiency	0.92
MP Turbine isentropic efficiency	0.91
LP Turbine isentropic efficiency	0.86
Pumps isentropic efficiency	0.75
Generator efficiency	0.98
Ancillaries consumption	5 %
Heat exchanger pressure drop (water-side)	2 bar
Evaporator pressure drop	5 bar

Live steam (13) is produced in the PFBC boiler at 180 bar and 550°C. The main assumptions of the steam cycle are exposed in Table 2. Steam is expanded in three stage turbine at 48.5 bar with reheating in Q4 (14-15), 19.4 bar to deaerator (24) and 0.05 bar to condenser (18). Due to the integration of low-temperature waste energy in CO₂ compression (Q1 to Q3) only one steam bleeding (24) is needed for deaerator.

3. Chemical Looping Cycle

3.1. Description

Chemical looping cycle (CLC) may be also considered as an oxyfuel technology, fuel reacts with oxygen transported by an oxygen carrier (usually a metal oxide) that previously has separated the oxygen from an air stream. Thus, one of the most important disadvantages of oxyfuel technologies, the elevated ASU power consumption is removed. For comparison purposes, the same thermal power and assumptions illustrated in Table 2 were selected for the CLC simulation. NiO/NiAl₂O₄ (40%/60% wt.) is used as oxygen carrier, due to its excellent performance at high temperatures [29,30]. A layout of the system is illustrated in Fig. 2 Air (1) is compressed and introduced at 10 bar in the CFB air reactor (2) with metal particles from fuel reactor (7) that arrives at 950°C. Metal oxidizes in an exothermic reaction at 1050°C producing an oxygen depleted air stream (3) that is introduced in a gas turbine producing power.

Table 3. Properties of oxy-PFBC streams.

Stream	Temperature (°C)	Pressure (bar)	Mass flow (kg/s)
1	820.0	12.0	145.0
2	390.0	1.1	145.0
3	235.0	1.1	145.0
4	60.0	1.1	145.0
5	60.0	1.1	140.2
6	60.0	12.2	81.8
7	354.2	12.2	81.8
8	60.0	1.1	140.2
9	60.0	3.5	140.2
10	60.0	12.2	140.2
11	60.0	37.5	53.4
12	60.0	120.0	53.4
13	550.0	180.0	146.4
14	351.3	50.0	146.4
15	549.5	50.0	146.4
16	231.6	4.5	146.4
17	231.6	4.5	139.5
18	32.9	0.05	139.5
19	32.9	0.05	139.5
20	32.9	6.0	139.5
21	121.2	4.5	37.1
22	121.2	4.5	37.1
23	121.2	4.5	65.4
24	231.6	4.5	6.9
25	121.2	4.5	139.5
26	147.9	4.5	146.4
27	151.4	185.0	146.4
28	15.0	1.0	192.3
29	29.9	5.1	192.3
30	29.9	5.1	4.1
31	29.9	5.1	188.2
32	29.9	5.1	131.7
33	29.9	11.0	131.7
34	-164.1	11.0	131.7
35	29.9	5.1	56.45
36	-175.2	5.1	56.45
37	-180.1	3.6	109.1
38	-175.8	3.6	79.0
39	-180.1	3.6	109.1
40	-182.2	2.4	79.0
41	-202.1	1.5	44.1
42	-202.1	12.2	44.1
43	15.0	12.0	44.1
44	-191.2	1.5	144.1
45	-180.4	1.5	144.1
46	-3.2	1.5	144.1

The last quantity includes recirculation compression. There is an efficiency gain due to the absence of the air compression. As a consequence 37.6 MW_e and 6.8 efficiency points are saved in oxy-PFBC. From an energetic point of view, the main energy losses are located in the ASU. Oxygen production involves a large amount of energy due to the compressors used to obtain the appropriate pressure for the distillation columns operation, about 41.3 MW_e. It represents the 21.1% of the net power output. In literature, the energy needed for the oxygen production is between 7-10% of the total system input [18]. In this case the value calculated is 7.5% with a final consumption of 246.9 kWh/tO₂. This value is similar to other values found [18, 24, 25, 26], for the current purity of the O₂ stream, although the outlet pressure is 12.2 bar, larger than in other CCS applications. Evidently the oxygen production consumption should be decreased and manufacturers attempt to achieve values around 180 kWh/tO₂. It would mean that the penalty could reduce from 7.5 to 5.5 efficiency points.

Flue gases at 820°C and 12 bar are expanded in a CO₂ turbine after the pressurized bed. The power produced by this turbine is 55.7 MW_e. This quantity is bigger than the reduction in compression necessities when the CO₂ at 12 bar is directly led to compression and storage. After the CO₂ turbine, the stream is cooled down to 390°C in a steam cycle high-pressure heater working as economizer.

Table 4. Analysis of performance of energy conversion in oxy-PFBC.

Energy input	550.0(MW_{th})
Steam turbine output	222.7 (MW_e)
CO ₂ turbine output	55.7 (MW_e)
ASU consumption	41.3(MW_e)
CO ₂ compression consumption	36.1(MW_e)
Net power output	196.9(MW_e)
Net overall efficiency	35.81(%)
Steam production	146.1(kg/s)
Intercooling waste heat	36.0(MW_{th})
Heat recovery after CO ₂ turbine	17.4 (MW_{th})

CO₂ final conditions after four compression stages are 120 bar and 60°C. The power consumption for compression is limited by intercooling between compressors. Intercooling compression reduces the power penalty and waste energy is integrated as low pressure heaters in the steam cycle.

The total compression necessities are 36.1 MW_e. On the other hand, there are 36 MW_{th} that could be integrated in the low pressure section of the steam cycle, avoiding the necessity of steam bleeding and increasing the power output in this turbine.

A live steam flow of 146.1 kg/s (180 bar/550°C) drive the turbines producing 223.2 MW_e. Reheating section (50 bar/549°C) is located inside the bed combustor. A small bleeding mass flow (7.2 kg/s) is necessary for deaerator. The low pressure section is preheated by the compression intercooling as it has been already described.

The flue gases moisture content after the combustion is around 4%. After CO₂-stream is dehydrated, the species concentrations in the recycled and capture stream are: CO₂ 92.92 %; H₂O 0.71 %; O₂ 2.8 %; SO₂ 0.034 %; N₂ 3.9 % (w).

The exergetic efficiency of the cycle is 45.35%. For this study the plant is divided in five subsystems: Air Separation Unit (ASU), pressurized boiler, CO₂ turbine, steam cycle and CO₂ compression system, fig.1.

The lowest exergy efficiency of the system is located in the ASU (table 5), where the efficiency is similar to previous references [43], around 28.5 %. It is caused mainly by oxygen separation and the heat exchangers irreversibility. The exergy input to this subsystem is electricity consumption and the output is a pressurized flow of oxygen.

Any other stream (nitrogen) is included as exergy losses, although it should be used elsewhere in the system. ASU irreversibility represents a 6% of the exergy fuel input, similar values are found in the literature [8]. It highlights again the importance of this equipment in order to achieve an efficient CCS system. Efforts should be done to optimize energetically and exergetically the ASU.

As expected, the highest irreversibility is associated with the combustion and heat transfer to

steam cycle. Despite the low combustion temperature, usual values, around 63%, are obtained for this equipment. Exergy input is formed by the fuel, 522.5 MW; the oxygen produced in the ASU, 8.1 MW; recycled CO₂ stream, 9.4 MW; and the water preheated before being fed to the reactor, 27.4 MW. This exergy input is divided in 229.7 MW for steam cycle, 89 MW for flue gases directed to CO₂ turbine and 209.5 MW of exergy losses.

Exergy losses are much lower in CO₂ turbine, compression system and steam cycle. Gas turbine irreversibility is 12.1 MW, which represents 13.6 % of flue gas exergy.

There is a high exergy efficiency of CO₂ compression 85.3 %, due to the final CO₂ stream is considered a "product". If this CO₂-stream is considered a loss, the efficiency drastically decreases to 46.3%. Regarding to the steam cycle, there is not a large scope for improvements as irreversibility amounts a 10% of total exergy input to this system.

As a conclusion, it should be noticed that the exergy penalty is not as important as energy penalty for the CO₂ capture equipment. In quantity, the main cause of irreversibility is fuel combustion with approximately the same percentage as air combustion.

CO₂ compression does not seriously affect energetic penalty and definitely the efforts should be developed to improve the oxygen production process as ASU exergy efficiency is significantly low. This point is essential to the success of the oxy-fuel technology.

In order to quantify the boiler pressure as the influential variable in oxy-PFBC, a sensitivity analysis has been performed. Without taking into account mechanical difficulties of operating under high pressure, calculations show (fig. 3) that an increase of the pressure in the reactor lead to important augmentation of energy and exergy efficiencies when the pressure is in the range 12-18 bar.

Above this pressure, both efficiencies have only a slight increase. The optimum point could be calculated if these results are complemented by an economic analysis. The main reasons are the power production in CO₂ turbine and the increase in intercooling waste energy that could be used in steam cycle.

Table 5. Analysis of performance of exergy conversion in oxy-PFBC.

PFBC	Exergy	Efficiency
Reactor		63 %
Exergy input	540.0 MW	
Irreversibility	209.5 MW	
Steam cycle		81.7 %
Exergy input	310.3 MW	
Irreversibility	56.9 MW	
CO₂ Compression		96.7%
Exergy input	21.7 MW	
Irreversibility	0.7 MW	
CO₂ Heat Exchangers		96.7%
Exergy input	87 MW	
Irreversibility	2.8 MW	
Gas Turbine		83.2 %
Exergy input	89.02 MW	
Irreversibility	14.9 MW	
ASU		28.5%
Exergy input	45.9 MW	
Irreversibility	32.8 MW	
PFBC Exergetic Efficiency		45.4 %

Table 6. Properties of CLC streams.

Stream	Temperature (°C)	Pressure (bar)	Mass flow (kg/s)
1	15.0	1.0	655.2
2	316.6	10.0	655.2
3	1050.0	10.0	614.7
4	543.8	1.3	614.7
5	950.0	10.0	109.5
6	177.5	10.0	54.3
7	950.0	10.0	69.1
8	15.0	1.0	22.8
9	950.0	10.0	109.5
10	600.3	1.0	109.5
11	152.0	1.0	109.5
12	90.0	1.0	109.5
13	34.0	1.0	106.9
14	146.0	3.3	106.9
15	60.0	3.3	106.9
16	177.5	10.9	106.9
17	60	10.9	52.6
18	177.5	35.9	52.6
19	60.0	35.9	52.6
20	178.8	120.0	52.6
21	60.0	120.0	52.6
22	34.0	0.06	2.6
23	128.5	3.0	43.7
24	132.0	128.0	43.7
25	132.0	128.0	19.9
26	490.0	120.0	23.9
27	257.8	21.5	43.8
28	128.5	3.0	59.3
29	131.0	31.0	59.3
30	490.0	20.0	103.0
31	261.3	3.0	103.0
32	261.3	0.05	0.9
33	261.3	3.0	102.1
34	32.9	0.05	102.1
35	30.9	0.05	102.1
36	30.9	3.0	102.1
37	106.4	3.0	102.1
38	123.5	3.0	102.1
39	150.0	1.3	614.7
40	138.3	1.3	614.7

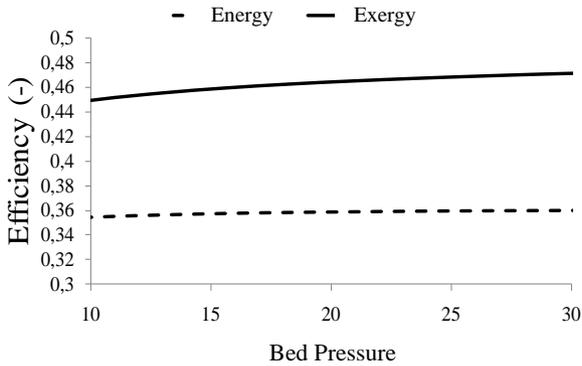


Fig. 3: Exergy and energy efficiencies vs pressure boiler.

4.2. Chemical Looping

In this case, table 6 show the thermodynamics variables, the net power output is 279.8 MW_e (table 7) for the same coal input as the example described before, 550 MW_{th}. Net system efficiency amounts 50.9%.

This value is lower than other reported in literature, 52.2% [44], but the use of gaseous fuel in CLC should results in higher efficiency. Nevertheless, it remains higher than other CO₂ capture systems.

For this system the main penalty is associated to the CO₂ compression up to 120 bar, 29.9 MW_e and 5.4 efficiency points. The oxygen depleted air turbine after the air reactor (AR) produces 356.7 MW_e and 614.8 kg/s of flue gases at 543.8°C. This power is partly used to drive the air compressor (199.8 MW_e). As a result, the net gas turbine power is 156.9 MW_e which represents the 48.1% of the gross power output.

Before being compressed, CO₂/H₂O stream (109.5 kg/s) is expanded in CO₂ turbine generating 47.6 MW_e, and at the same time, gas temperature is reduced to 600.3°C. After this stage, gases are cooled down in a small HRSG recovering 54.9 MW_{th} and exhausting the gases at 152.0 °C. Another heat exchanger reduces gas temperature while the condensate water is preheated. Finally, an additional heat exchanger works as condenser with ambient as cold reservoir in order to separate water vapour from the CO₂ stream before compression (2.6 kg/s).

HRSG after air turbine generates 83.1 kg/s of live steam at 490°C and the small HRSG after the CO₂ turbine produces 19.9 kg/s in a parallel branch. As a result, steam turbine power output is 119.8 MW_e. Steam cycle is completed using the waste energy of intercooling compression that provides 25.8 MW_{th} that are used to preheat condensate water before entering in the deaerator, to increase condensate temperature from 30.9°C to 106.4°C and to minimize the steam bleeding between the two low-pressure steam turbine stages.

Table 7. Analysis of performance of energy conversion in CLC.

Energy input	550.0 (MW _{th})
Steam turbine output	119.8 (MW _e)
Gas turbine output	156.9 (MW _e)
CO ₂ turbine output	47.7 (MW _e)
CO ₂ compression consumption	29.9 (MW _e)
Net power output	279.8 (MW _e)
Net overall efficiency	50.9 (%)
Steam production	103.0 (kg/s)
Intercooling waste heat	25.8 (MW _{th})
Heat recovery steam generator	314.5 (MW _{th})

In order to analyse the irreversibilities of the power plant, it has been divided in six subsystems: gas turbine, reactors, CO₂ turbine, CO₂ exchangers, rankine cycle and CO₂ compression to perform a CLC exergy analysis. Again, as it was expected, the main irreversibility is produced in the air and fuel reactors, 83.9 MW (table 8). This value implies an exergy efficiency of 88.4%. As before, it is needed to highlight the importance of the exergy streams considered as product. Generally, exergy associated with work is taken as a product, as well as heat exergy flows in the heat exchangers. In order to calculate this exergy efficiency, the CO₂/H₂O flow and the oxygen depleted air were considered as products that are going to be used in other equipment. This is not the unique way to define the exergy and another definition can take as a product the balance of exergy of the air current, reducing the exergy efficiency to 84.2%. In both cases, it is evident that chemical reactions are the main cause of exergy losses. They highlight the conclusion above presented, CO₂ capture does not imply as high exergy penalties as energetic penalties.

Table 8. Analysis of performance of exergy conversion in CLC.

Chemical Looping	Exergy	Efficiency
Gas turbine		
Exergy input	178.8 MW	87.8 %
Irreversibility	21.9 MW	
Reactors		
Exergy input	722 MW	88.4 %
Irreversibility	83.9 MW	
CO₂ Turbine		
Exergy input	49.3 MW	96.7 %
Irreversibility	1.7 MW	
CO₂ Heat Exchangers		
Exergy input	48.7 MW	66.3 %
Irreversibility	16.4 MW	
Compressing stage		
Exergy input	21.2 MW	96.6 %
Irreversibility	0.7 MW	
Steam cycle		
Exergy input	170.8 MW	70.2%
Irreversibility	50.9 MW	
CLC Exergetic Efficiency		64.2 %

higher, 96.65% due to the absence of a compressor.

CO₂ heat exchangers have relatively low exergy efficiency, 66.25%, due to the necessity of water condensation before the CO₂ compression. Then, the irreversibility of compression stages is low, 0.72 MW (96.59% exergy efficiency). In this block, there are several criterion to carry out the exergy analysis. Compressed CO₂ and heat obtained from the intercooling exchangers are considered the products of the block. When the CO₂ outlet is taken as a loss of the subsystem, the efficiency is reduced to 51.52%. Finally, if the CO₂ flow is an exergy product, but the heat exchanged is a loss, the efficiency decreases to 75.6%, which reveals the high importance of heat recovering after each compression stage. Finally, steam cycle has an exergy efficiency of 70.16% which is influenced by mechanical losses, steam condensation and heat loss in the condenser, and irreversibility in the HRSG.

To analyse the influence of pressure in CLC energy and exergy performance it has been assumed that the oxygen carrier and fuel combustion are not affected. Increasing oxygen partial pressure should promote oxygen transportation but the influence of higher CO₂ and O₂ partial pressure in CLC of coal have not been experimentally proved. Some researchers have reported that increasing pressure does not imply the improvement that was expected [36]. In our calculations, the pressure augmentation slightly increases the energy efficiency of the overall CLC, from 49.5% at 8 bar to over 54% at 20 bar. Higher pressure does not show any beneficial effect, fig. 4.

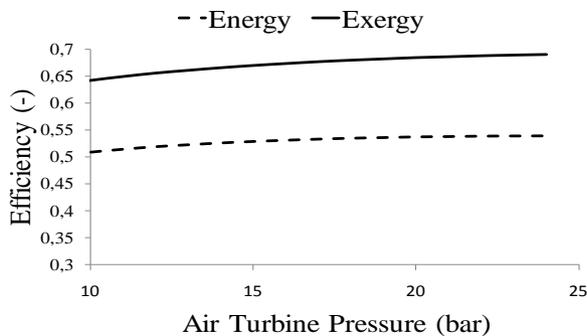


Fig. 4: The influence of inlet air turbine pressure on the energetic efficiency.

Similar tendency is observed for exergy efficiency in the range 8 bar to 20 bar, but near 20 bar, this value follows increasing whereas energetic efficiency seems to reach a steady value.

5. Conclusions

This work has compared the energy and exergy analysis of two oxyfuel pressurized combustion for CO₂ capture. An oxyfuel PFBC and a CLC using coal as fuel have been simulated and exergetically analysed to contrast energy and exergy penalties, to detect irreversibilities and to propose items for optimization. Although the energy penalty is high, exergy analysis show that CO₂ capture equipment does not have large irreversibility. In the analysed cases, fuel combustion remains to be the main cause of irreversibility with approximately the same percentage as in air combustion. For oxy-PFBC the exergy losses are 209.5 MW that represents a 37 %, and for CLC with coal the irreversibility is 83.9 MW that represents 11.6%.

CO₂ compression could affect the energetic penalty with reduction of 7 points in oxy-PFBC and 5.4 points in CLC. This difference is mainly produced by impurities of nitrogen and oxygen that have been considered in the fluidized bed, on the contrary, the combustion in CLC takes place by the stoichiometric oxygen without nitrogen impurities. Nevertheless, the exergy penalty is low in both cases, around 0.72 MW, it is due to the use of intercooling waste energy that minimize the losses and the CO₂ final stream that has been considered as a product. It is worthy to notice that the exergy efficiency of oxygen production is low, 28.5%, and is should be a candidate to propose items for optimization of system re-design. One of the advantages is CLC compared with oxy-PFBC is that the ASU energy and exergy penalty is avoided. Steam cycle losses are not affected by the CO₂ capture and values are similar to systems in the state-of-the-art power plants. Both systems show energy and exergy efficiencies augmentation when the operational pressure is increased. The influence is stronger for lower pressures (12-18 bar) both in oxy-PFBC and CLC and then the increment is smooth. In all cases CLC shows larger energetic and exergy efficiencies than oxy-PFBC.

References

- [1] B. Metz, O. Davidson, H. de Coninck, M. Loos, L. Meyer (Eds.), *Special Report on Carbon Dioxide Capture and Storage*, Intergovernmental Panel on Climate Change, Cambridge University Press, 2005.
- [2] European Technology Platform for Zero Emission Fossil Fuel Power Plants. EU Demonstration Programme for CO₂ Capture and Storage (CCS). ZEP's Proposal, European Technology Platform for Zero Emission Fossil Fuel Power Plants (ZEP), 2007.
- [3] Y. Hao, D. Golom, G. Brown, Natural gas fired combined cycle power plant with CO₂ capture, *Energy Conversion and Management* 36-12 (1995) 1115-1128.
- [4] F.H. Geuzebroek, L.H.J.M. Schneider, G.J.C. Kraaijeveld, Exergy Analysis of Amine-Based CO₂ Removal Technology, *Greenhouse Gas Control Technologies - 6th International Conference* (2003) 121-126.
- [5] F.H. Geuzebroek, L.H.J.M. Schneider, G.J.C. Kraaijeveld, P.H.M. Feron, Exergy analysis of alkanolamine-based CO₂ removal unit with AspenPlus, *Energy* 29 9-10 (2004) 1241-1248.
- [6] W. Cao, D. Zheng, Exergy regeneration in an O₂/CO₂ gas turbine cycle with chemical recuperation by CO₂ reforming of methane, *Energy Conversion and Management* 47 18-19 (2006) 3019-3030.
- [7] W. Cao, D. Zheng, Thermodynamic performance of O₂/CO₂ gas turbine cycle with chemical recuperation by CO₂-reforming of methane, *Fuel* 86 17-18 (2007) 2864-2870.
- [8] N. Zhang, N. Lior, Two novel oxy-fuel power cycles integrated with natural gas reforming and CO₂ capture, *Energy* 33 2 (2008) 340-351.
- [9] X. Zhang, W. Han, H. Hong, H. Jin, A chemical intercooling gas turbine cycle with chemical-looping combustion, *Energy* 34 12 (2008) 2131-2136.
- [10] J. Wolf, M. Anheden, J. Yan, Comparison of nickel- and iron-based oxygen carriers in chemical looping combustion for CO₂ capture in power generation, *Fuel* 84 7-8 (2005) 993-1006.
- [11] P. Chiesa, P.G. Lozza, A. Malandrino, M. Romano, V. Piccolo, Three-reactors chemical looping process for hydrogen production, *International Journal of Hydrogen Energy* 33 9 (2009) 2233-2245.
- [12] P. Lisbona, L.M. Romeo, Enhanced Coal Gasification Heated by Unmixed Combustion integrated with an Hybrid System of SOFC/GT, *International Journal of Hydrogen Energy* 33 (2008) 5755-5764.
- [13] A.P. Simpson, A.J. Simon, Second law comparison of oxy-fuel combustion and post-combustion carbon dioxide separation, *Energy Conversion and Management* 48 11 (2007) 3034-3045.
- [14] C. Gou, R. Cai, H. Hong, A novel hybrid oxy-fuel power cycle utilizing solar thermal energy, *Energy* 32 9 (2007) 1707-1714.
- [15] I.S. Ertesvåg, H.M. Kvamsdal, O. Bolland, Exergy analysis of a gas-turbine combined-cycle power plant with precombustion CO₂ capture, *Energy* 30 1 (2005) 5-39.
- [16] D. Fiaschi, L. Tapinassi, Exergy analysis of the recuperative auto thermal reforming (R-ATR) and recuperative reforming (R-REF) power cycles with CO₂ removal, *Energy* 29 12-15 (2004) 2003-2024.
- [17] A. Corrado, P. Fiorini, E. Sciubba, Environmental assessment and extended exergy analysis of a "zero CO₂ emission", high-efficiency steam power plant, *Energy* 31 15 (2006) 3186-3198.
- [18] N. Zhang, N. Lior, A novel near-zero CO₂ emission thermal cycle with LNG cryogenic exergy utilization, *Energy* 31 10-11 (2006) 1666-1679.
- [19] L.M. Romeo, S. Usón, A. Valero, J.M. Escosa, Exergy analysis as a tool for the integration of very complex energy systems: The case of carbonation/calcination CO₂ systems in existing coal power plants, *International Journal of Greenhouse Gas Control* 4 4 (2010) 647-654.
- [20] J. Hong, G. Chaudhry, J.G. Brisson, R. Field, M. Gazzino, A.F. Ghoniem, Analysis of oxy-fuel combustion power cycle utilizing a pressurized coal combustor, *Energy* 34 9 (2009) 1332-1340.
- [21] M. Bryngelsson, M. Westermark, Feasibility study of CO₂ removal from pressurized flue gas in a fully fired combined cycle- the Sargas project. In proceedings of the 18th International Conference on Efficiency, Cost, Optimization, Simulation and Environmental Impact of Energy Systems, ECOS, Trondheim, Norway, Vol. 2 (2005) 703-710.
- [22] M. Bryngelsson, E.G. Lindfeldt, J. Heller, The modelling of a hybrid combined cycle with

- pressurised fluidised bed combustion and CO₂ capture, *International Journal of Greenhouse Gas Control* 3 3 (2009) 255-262.
- [23] H.J. Ryu, G.T. Jin, C.K. Yi, Demonstration of inherent CO₂ separation and no NO_x emission in a 50KWth chemical-looping combustor: continuous reduction and oxidation experiment, in: *Proceedings of the Seventh International Conference on Greenhouse Gas Control Technologies (GHGT-7)* (2004) 1907–1910.
- [24] R. Xiao, M.Y. Zhang, B.S. Jin, Y.Q. Xiong, H.C. Zhou, Y.F. Duan, Z.P. Zhong, X.P. Chen, L.H. Shen, Y. Huang, Air blown partial gasification of coal in a pilot plant pressurized spout-fluid bed reactor, *Fuel* 86 10–11 (2007) 1631–1640.
- [25] Z. Deng, R. Xiao, B. Jin, H. Huang, L. Shen, Q. Song, Q. Li, Computational fluid dynamics modelling of coal gasification in a pressurized spout-fluid bed, *Energy Fuels* 22 3 (2008) 1560–1569.
- [26] H. Leion, T. Mattisson, A. Lyngfelt, Solid fuels in chemical-looping combustion, *International Journal of Greenhouse Gas Control* 2 2 (2008) 180-193.
- [27] H. Leion, E. Jerndal, B.M. Steenari, S. Hermansson, M. Israelsson, E. Jansson, M. Johnson, R. Thunberg, A. Vadenbo, T. Mattisson, A. Lyngfelt, Solid fuels in chemical-looping combustion using oxide scale and unprocessed iron ore as oxygen carriers, *Fuel* 88 10 (2009) 1945-1954.
- [28] H. Leion, A. Lyngfelt, T. Mattisson, Solid fuels in chemical-looping combustion using a NiO-based oxygen carrier, *Chemical Engineering Research and Design* 87 11 (2009) 1543-1550.
- [29] T. Mattisson, H. Leion, A. Lyngfelt, Chemical-looping with oxygen uncoupling using CuO/ZrO₂ with petroleum coke, *Fuel* 88 4 (2009) 683-690.
- [30] T. Mattisson, A. Lyngfelt, H. Leion, Chemical-looping with oxygen uncoupling for combustion of solid fuels, *International Journal of Greenhouse Gas Control* 3 1 (2009) 11-19.
- [31] J. Adánez, C. Dueso, L.F. de Diego, F. García-Labiano, P. Gayán, A. Abad, Methane Combustion in a 500 Wth Chemical-Looping Combustion System Using an Impregnated Ni-Based Oxygen Carrier, *Energy Fuels* 23 1 (2009) 130–142.
- [32] P. Gayán, C.R. Forero, L.F. de Diego, A. Abad, F. García-Labiano, J. Adánez, Effect of gas composition in Chemical-Looping Combustion with copper-based oxygen carriers: Fate of light hydrocarbons, *International Journal of Greenhouse Gas Control* 4 1 (2010) 13-22.
- [33] P. Kolbitsch, J. Bolhàr-Nordenkamp, T. Pröll, H. Hofbauer, Operating experience with chemical looping combustion in a 120 kW dual circulating fluidized bed (DCFB) unit, *International Journal of Greenhouse Gas Control* 4 2 (2009) 180-185.
- [34] R. Xiao, Q. Song, M. Song, Z. Lu, S. Zhang, L. Shen, Pressurized chemical-looping combustion of coal with an iron ore-based oxygen carrier, *Combustion and Flame* 157 6 (2010) 1140-1153.
- [35] E.J. Anthony, Solid looping cycles: A new technology for coal conversion, *Ind. Eng. Chem. Res.* 47 6 (2008) 1747–1754.
- [36] F. García-Labiano, J. Adánez, L.F. de Diego, P. Gayán, A. Abad, Effect of pressure on the behaviour of copper-, iron-, and nickel-based oxygen carriers for chemical-looping combustion, *Energy Fuels* 20 1 (2006) 26–33.
- [37] S.A. Klein, Engineering equation solver (EES) for Microsoft windows operating systems, Madison USA, F-Chart Software, Available from: <http://www.fchart.com>.
- [38] L.M. Romeo, C. Cortés, Simulation of a full-scale pressurized fluidized bed combustor by using semi-empirical pilot plant correlations, *Revue Générale de Thermique* 37 (1998) 862-873.
- [39] S. Seddighi, D. Pallarés, F. Johnsson, One-dimensional modeling of oxy-fuel fluidized bed combustion for CO₂ capture, 2010 ECI Conference on The 13th International Conference on Fluidization - New Paradigm in Fluidization Engineering, paper (2011) 104.
- [40] J.M. Amann, M. Kanniche, C. Bouallou, Natural gas combined cycle Power plant modified into an O₂/CO₂ cycle for CO₂ capture, *Energy Conversion and Management* 50 (2009) 510-521.
- [41] L.M. Romeo, I. Bolea, Y. Lara, J.M. Escosa, Optimization of intercooling compression in CO₂ capture systems. *Applied Thermal Engineering* 29 8-9 (2009) 1744-1751.
- [42] F. Garcia-Labiano, L.F. de Diego, J. Adánez, A. Abad, P. Gayán, Temperature variations in the oxygen carrier particles during their reduction and oxidation in a chemical-looping com-

bustion system, *Chemical Engineering Science* 60 (2005) 851-862.

- [43] R. L. Cornelissen and G. G. Hirs, Exergy Analysis of cryogenic air separation, *Energy Convers. Mgmt* Vol. 39 16-18 (1998) 1821-1826.
- [44] R. Naqvi, J. Wolf, O. Bolland, Part-load analysis of a chemical looping combustion (CLC) combined cycle with CO₂ capture, *Energy* 32 (2007) 360-370.

Biographies



Isabel Guedea (Ph.D. student Mechanical Engineer), is a Chemical Engineer Researcher that has been working on CO₂ capture within the Thermal Division of Circe Foundation during the last four years. Her research is focused in design and built oxy-firing fluidized bed, instrumentation and automa-

tion of pilot plants and CO₂ capture cycles simulation.



Carlos Lupiáñez (Ph.D. student Mechanical Engineering), is a Mechanical Engineer Researcher in CIRCE during last five years. His research is focused in CO₂ capture systems. He took part in CIRCE oxy-firing fluidized bed design and nowadays he is studying SO₂ and NO_x emission under oxy-firing conditions.



Luis M. Romeo (Ph.D. Mechanical Engineer), is a Project Manager in CIRCE and lecturer of “Thermal System Simulation” and “Zero Emissions Technologies, Carbon Capture and Storage” at the University of Zaragoza. His research is focused in energy integration and CO₂ capture systems (oxyfuel and CFB looping)